


REQUIREMENTS FOR ENTRANCE PERMITS RESIDENTIAL


NOTE: -ENTRANCE PERMIT MUST BE APPROVED BEFORE WORK COMMENCES.
-MUNICIPALITY TO BE NOTIFIED FOR INSPECTION OF INSTALLATION.

1. Location must be staked out.
2. When a culvert is required in a road ditch, the grade shall be at a depth of the original Municipal ditch bottom.
3. The diameter of the culvert shall be determined by the Engineering Department
The length of the culvert shall be a minimum of 24 feet.
4. The Entrance surface width shall be a minimum of 20 feet.
5. The headwalls shall be built with RIP RAP STONE AND FILTER CLOTH or JUTE BAGS FILLED WITH CONCRETE so that a 20ft. width can be maintained.
6. Backfill with granular "B" at the culvert.
7. Entrance to driveway shall be constructed with a minimum surface treatment of granular "A", with a minimum thickness of 150mm (6").

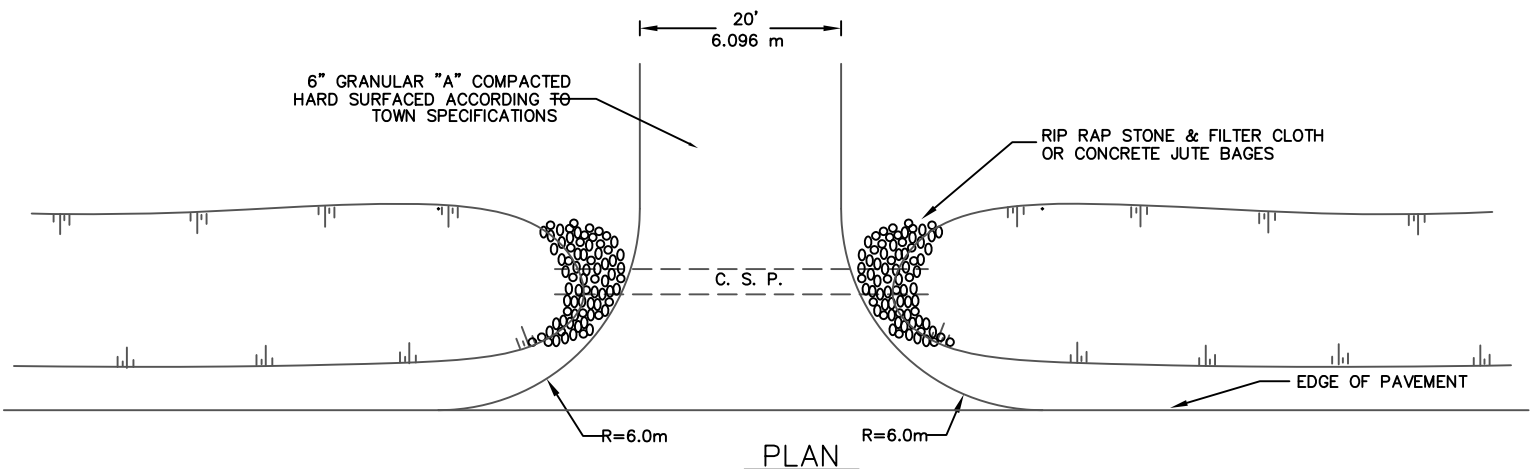

Note:

1. Size of Quarried Limestone to be 100mm(4") - 250mm(10")
2. Geotextile Fabric to be terrafix 270-R or Equal

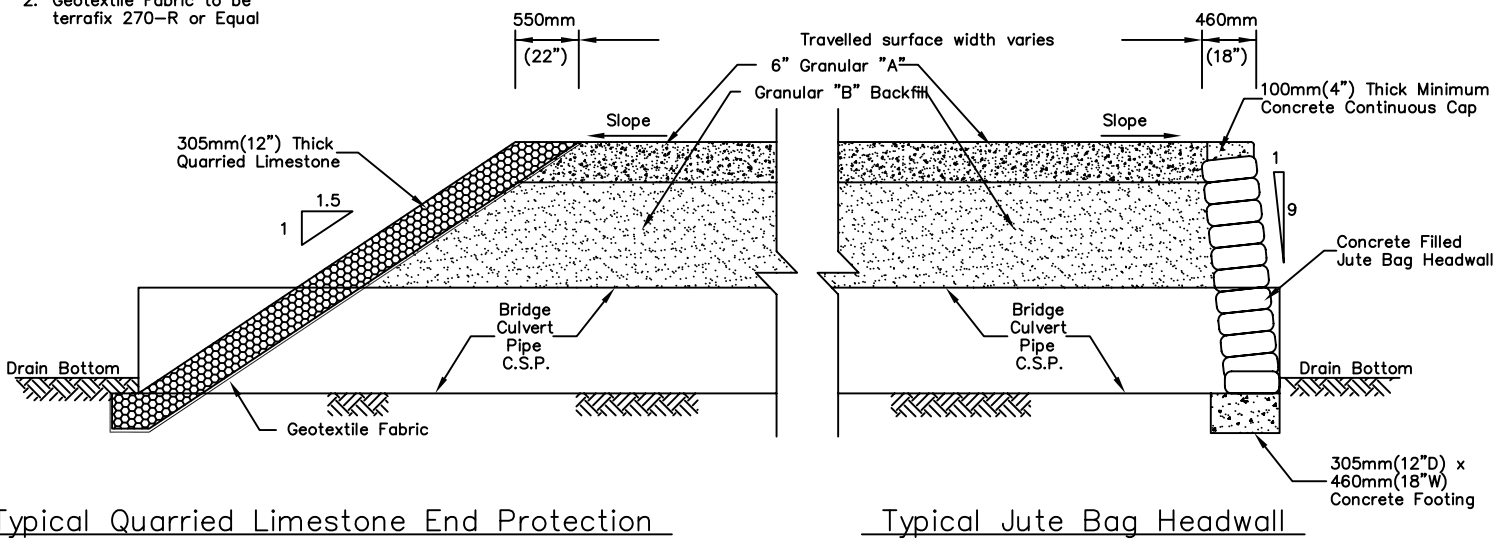

TITLE:

RURAL ENTRANCE



DWG DATE:
FEB 20, 2013

REVISION DATE:
MAR. 23, 2015

DWG NO:
304