



PAVED DRIVEWAY ENTRANCE

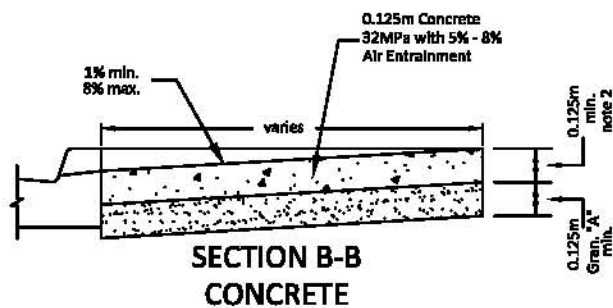

**SECTION B-B
CONCRETE**

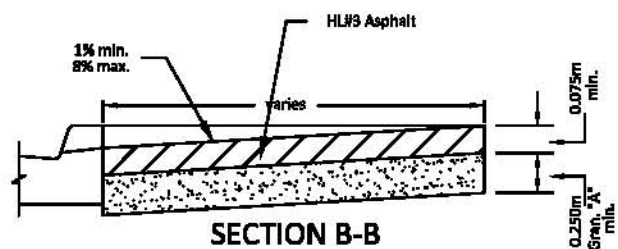

**SECTION B-B
ASPHALT**

NOTES:

1. All concrete shall be 32MPa with 5.0% - 8.0% air content and maximum slump of 70mm.
2. Cast iron access caps required.
3. All dimensions are in metres unless otherwise shown.
4. Expansion joints required at curb for concrete approach.
5. Granular "A" to be compacted to 100% Standard Proctor Density
6. Curb cuts to be made with approved curb cutting machine. Sawcutting and breaking away is not permitted.
7. All concrete surfaces to be broom finished and edged.
8. HL#3 asphalt to be compacted to 98% Standard Proctor Density.

REQUIRED INSPECTIONS:

1. After excavation to sub base.
2. After compaction of granular "A" and placement of forms.
3. After driveway is complete and forms are removed and boulevard is restored.

ALL INSPECTIONS MUST BE COMPLETED BY THE ENGINEERING DEPARTMENT BEFORE REFUND OF THE DEPOSIT.

TITLE: RESIDENTIAL DRIVEWAY - URBAN WITHOUT SIDEWALK



DWG DATE: FEB 20, 2013

REVISION DATE:

DWG NO: 300