


NOTE: SEPARATION BETWEEN WATER SERVICE CONNECTION TO EITHER SANITARY OR STORM CONNECTION SHALL BE 2.5m MINIMUM. AS PER M.O.E. REGULATIONS.



TYPICAL SERVICE LAYOUT SEMI-DETACHED LOTS

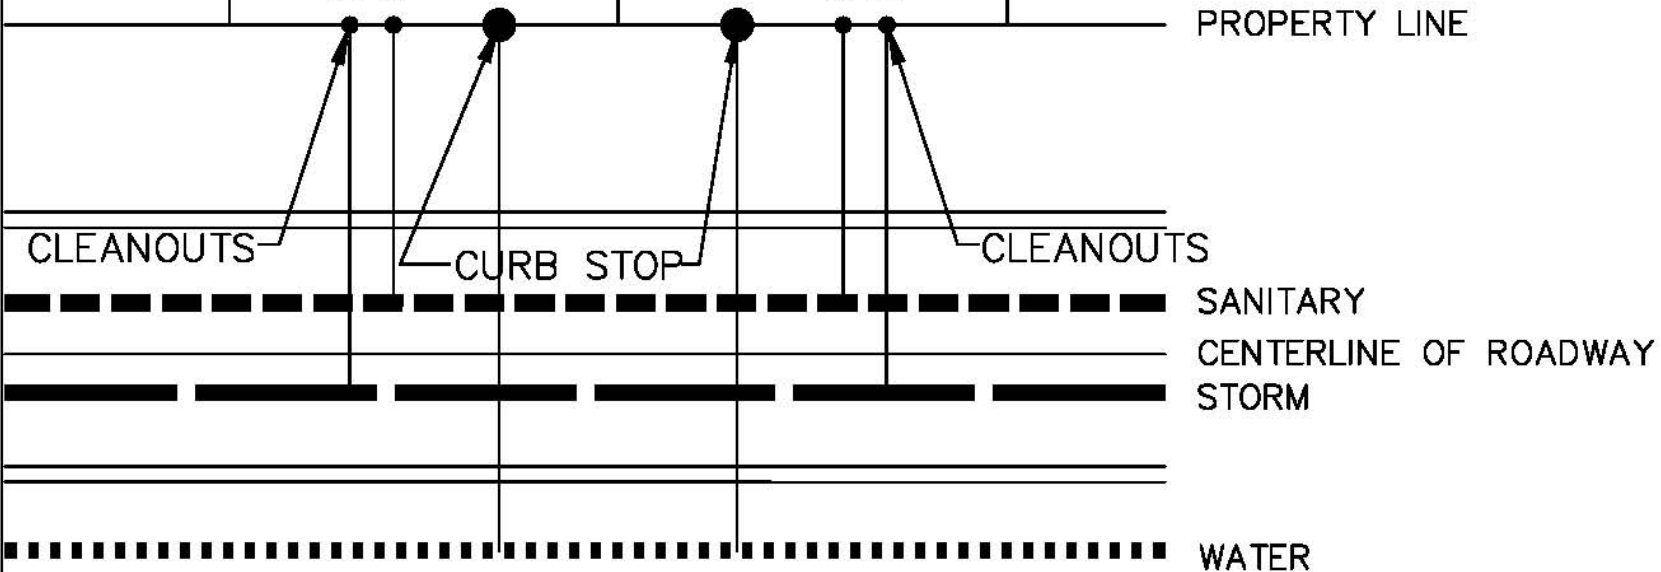

DWG DATE: FEB 20, 2013

REVISION DATE:

DWG NO: 1001